

- GENERAL NOTES
- THE DRAWINGS DEPICTED HEREIN REPRESENT PRELIMINARY LAYOUTS OF A WASTEWATER TREATMENT SYSTEM CAPABLE OF TREATING THE DOMESTIC WASTE CONSTITUENTS NOTED IN TABLE 1.
 - ECOPOD REACTOR BOX SHALL BE CONSTRUCTED OF AISI 304/304L STAINLESS STEEL.
 - TANK MATERIAL OPTIONS:
 - CARBON STEEL PER ASTM A36 w/COATING PER DELTA STANDARDS,
 - FIBERGLASS REINFORCED PLASTIC (FRP) (NOT ALL MODELS),
 - PRECAST CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS,
 - CAST-IN-PLACE CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 - BLOWERS, WEIRS, CONTROL PANELS, AND VARIOUS SMALL PARTS WILL BE SHIPPED UNASSEMBLED AND SECURELY PACKAGED, TO BE INSTALLED BY CONTRACTOR.
 - SEE INSTALLATION GUIDE FOR INSTALLATION DETAILS.
 - CONTACT AN IWT/DELTA REPRESENTATIVE REGARDING DEVIATIONS FROM THESE STANDARDS.

TABLE 1
PROCESS PARAMETERS
DELTA E1000S BOD ONLY

PARAMETER	MINIMUM	MAXIMUM
AVERAGE DAILY FLOW	-	10,000 GPD
PEAK DAILY FLOW	-	15,000 GPD
INFLUENT BOD ₅	-	25 LB/DAY
AIR TEMPERATURE	-	115 °F
WATER TEMPERATURE	68 °F	68 °F
RELATIVE HUMIDITY	10%	90%
SITE ELEVATION	0 FT AMSL	3,000 FT AMSL

TABLE 2
AIR DEMAND

PARAMETER	UP TO 1,000 FT AMSL	1,000 TO 3,000 FT AMSL
STANDARD AIRFLOW	220 SCFM	256 SCFM
SITE AIR REQUIREMENT	248 ICFM	307 ICFM
BLOWER INLET AIR	248 ICFM	307 ICFM
AIR HEADER SIZE	4 IN	4 IN
MIN. TANK VENT X-SECT. AREA	102 IN ² 2 EA 10" OR 1 EA 12"	126 IN ² 3 EA 8" OR 2 EA 10"
BLOWER SELECTION	G-D SUTORBILT 3L	G-D SUTORBILT 3L
NOISE LEVEL	ENCLOSURE DEPENDENT	ENCLOSURE DEPENDENT
AIR TEMPERATURE RISE ¹	21 F (11.7 C)	20 F (11.1 C)
BLOWER INLET DIAMETER	2.5 IN NPT	2.5 IN NPT
BLOWER OUTLET DIAMETER	2.5 IN NPT	2.5 IN NPT
MOTOR POWER RATING ²	5 HP	5 HP
OPERATING POWER	2.1 KW	2.5 KW

- REVIEW BLOWER DISCHARGE AIR TEMPERATURE WHEN SPECIFYING AIR MAIN PIPING MATERIAL.
- REVIEW BLOWER MANUFACTURER CUTSHEETS FOR ADDITIONAL ELECTRICAL INFORMATION.


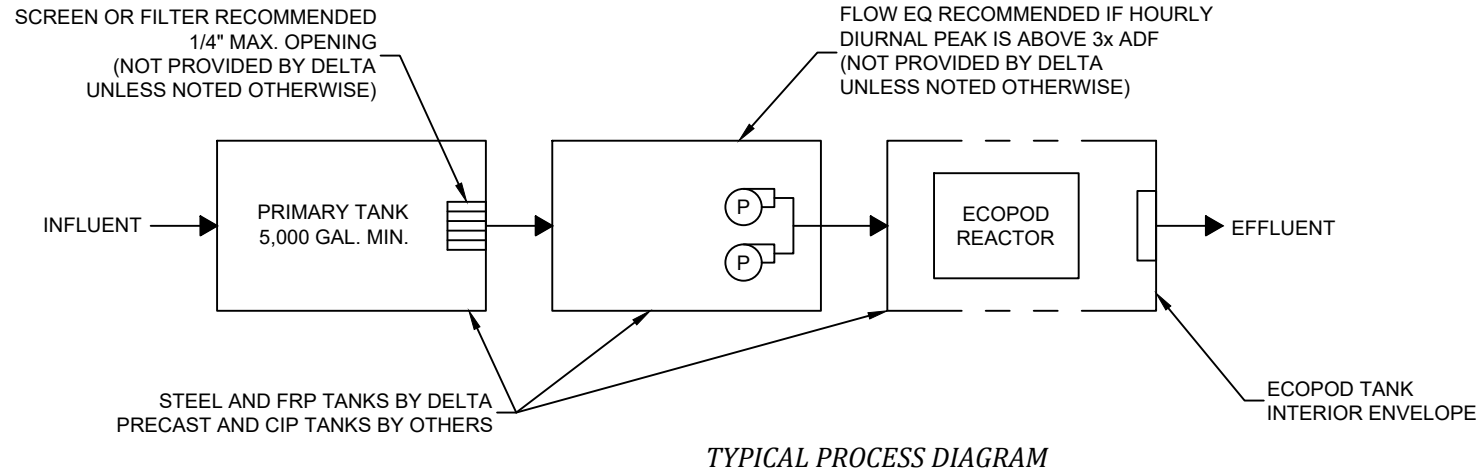



TABLE 3
STANDARD EQUIPMENT LIST

DESCRIPTION	QTY	MAKE	MODEL
ECOPOD REACTOR	1	DELTA	E1000S
BLOWER	1	G-D SUTORBILT	PER TABLE 2
CONTROL PANEL	1	DELTA	PER DESIGN
24" S.S. EFFLUENT WEIR	1	DELTA	TROUGH-3.0

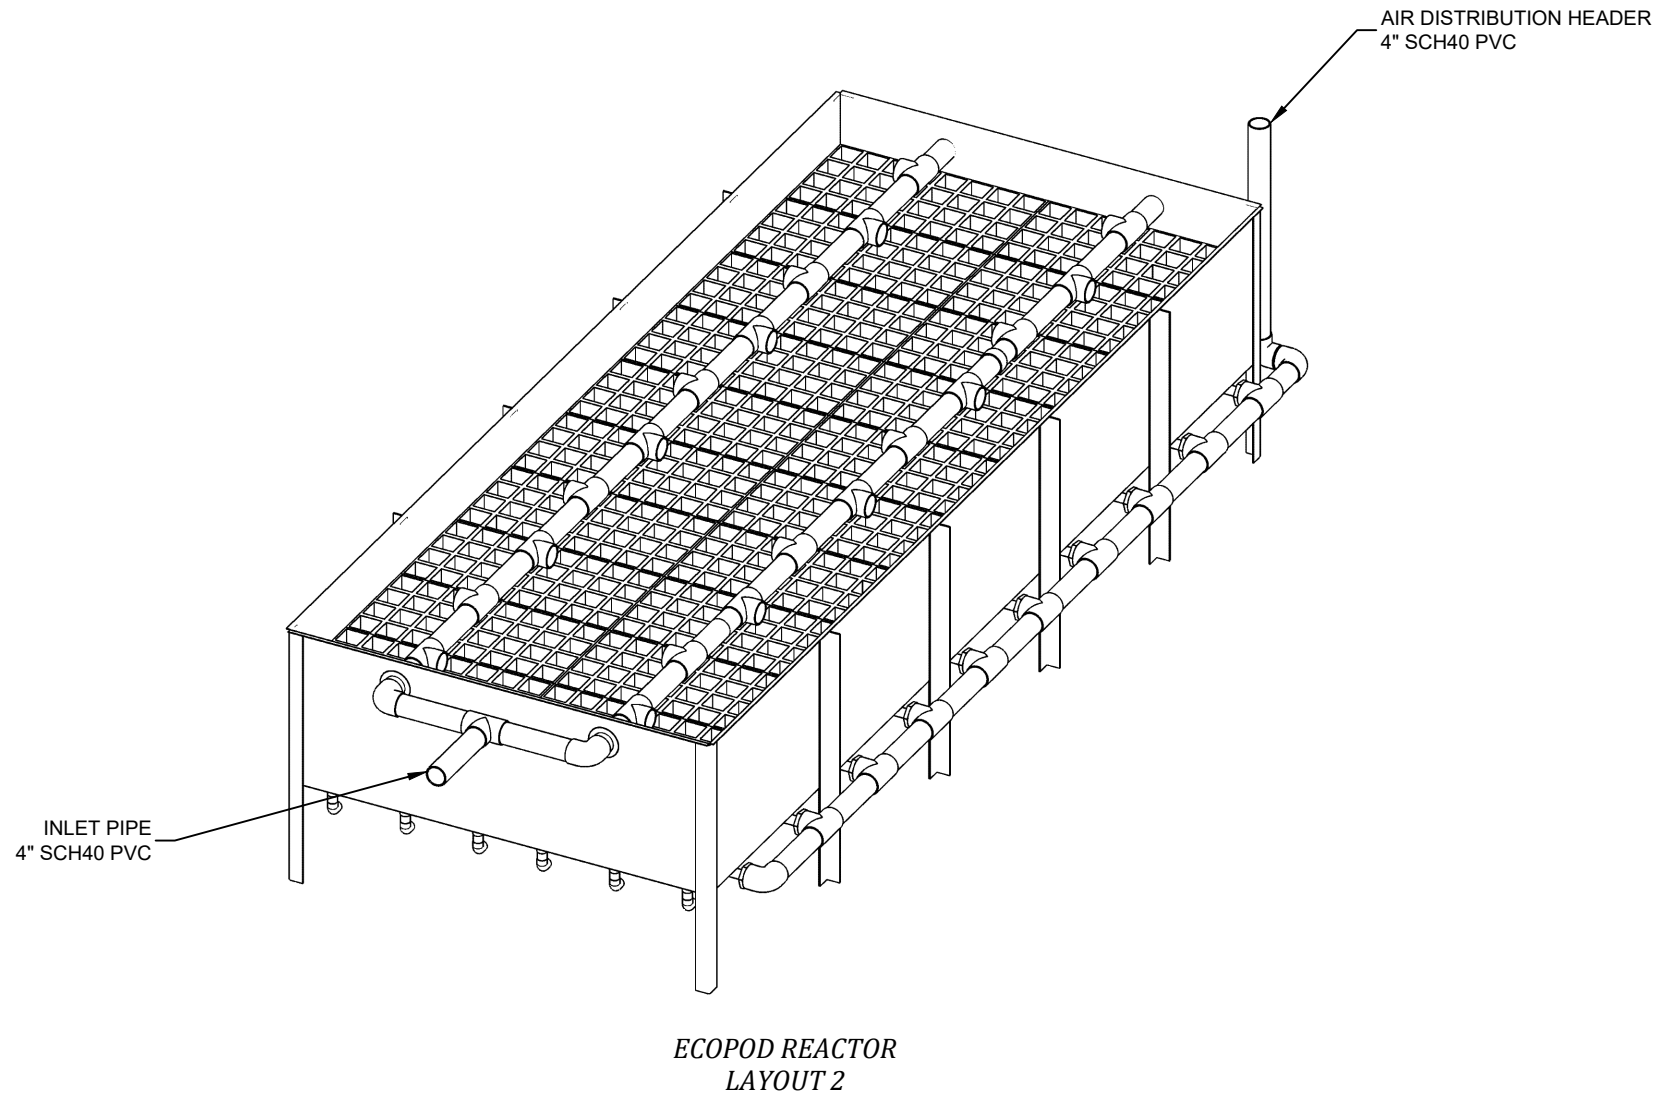

NO.	DATE	INITIALS	DESCRIPTION
A	10/12/21	AOB	ADDED TRIMETRIC VIEW


Delta Treatment Systems, LLC
 An Infiltrator Water Technologies Company
COPYRIGHT (C) 2021 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF DTS. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.

DELTA ECOPOD E1000S
STANDARD DESIGN FOR BOD REDUCTION
GENERAL ARRANGEMENT
DESIGN OVERVIEW

HORIZ. SCALE	PROJECT NO.
N/A	N/A
VERT. SCALE	DATE
N/A	02/11/2021
DRAWN BY	DESIGNED BY
CGK	AOB
DRAWING NO.	SHEET NO.
C1.0	01 of 02

C:\Users\kva\OneDrive\Desktop\Drawings\Systems\DEP - Drawings\Products\ecoPod\STANDARD COMMERCIAL WORK IN PROGRESS\ecoPod Commercial\ecoPod Drawings\WIP Rev A.dwg

- GENERAL NOTES
- ECOPOD REACTOR BOX SHALL BE CONSTRUCTED OF AISI 304/304L STAINLESS STEEL.
 - TANK MATERIAL OPTIONS:
 - CARBON STEEL PER ASTM A36 w/COATING PER DELTA STANDARDS.
 - FIBERGLASS REINFORCED PLASTIC (FRP) (NOT ALL MODELS).
 - PRECAST CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 - CAST-IN-PLACE CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 - SEE INSTALLATION GUIDE FOR INSTALLATION DETAILS.
 - CONTACT AN IWT/DELTA REPRESENTATIVE REGARDING DEVIATIONS FROM THESE STANDARDS.

SITE ELEVATION		LAYOUT ID	REACTOR WEIGHT		A OVERALL LENGTH		B OVERALL WIDTH		B1 AIR HEADER CL DIM	
FT	M		LB	KG	IN	CM	IN	CM	IN	CM
0-3,000	0-914	2	2,110	958	263	669	108	275	57	145
0-3,000	0-914	3	2,380	1,080	348	884	84	214	45	115


1. SOME REACTOR LAYOUTS NOT AVAILABLE IN FIBERGLASS TANKS. CONTACT AN IWT/DELTA REPRESENTATIVE FOR DETAILS.

DIMENSION	IN	CM
C VESSEL FRONT SPACE	12	30
D VESSEL REAR SPACE	18	46
E AIR HEADER SIDE INSIDE SPACE	6	15
F NO HEADER SIDE INSIDE SPACE	6	15


1: ADDITIONAL ACCESS HATCHES RECOMMENDED FOR SOLIDS REMOVAL ALONG VESSEL SIDES.

DIMENSION	IN	CM
G INLET INVERT	50	127
H PLENUM SPACE ABOVE INLET INVERT	10	25
J MEDIA REACTOR HEIGHT	59	150
K OUTLET INVERT	47	119

1. ONE (1 EA.) INLET AND ONE (1 EA.) OUTLET ACCESS HATCH REQUIRED, 24" DIA MINIMUM.

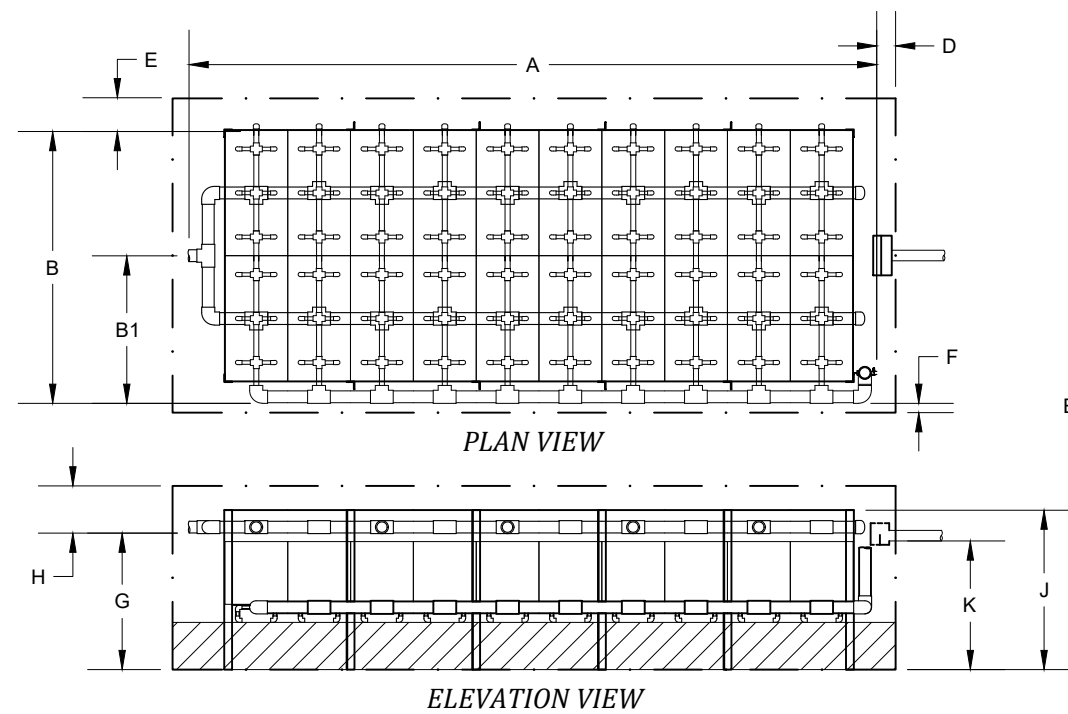


LAYOUT 2

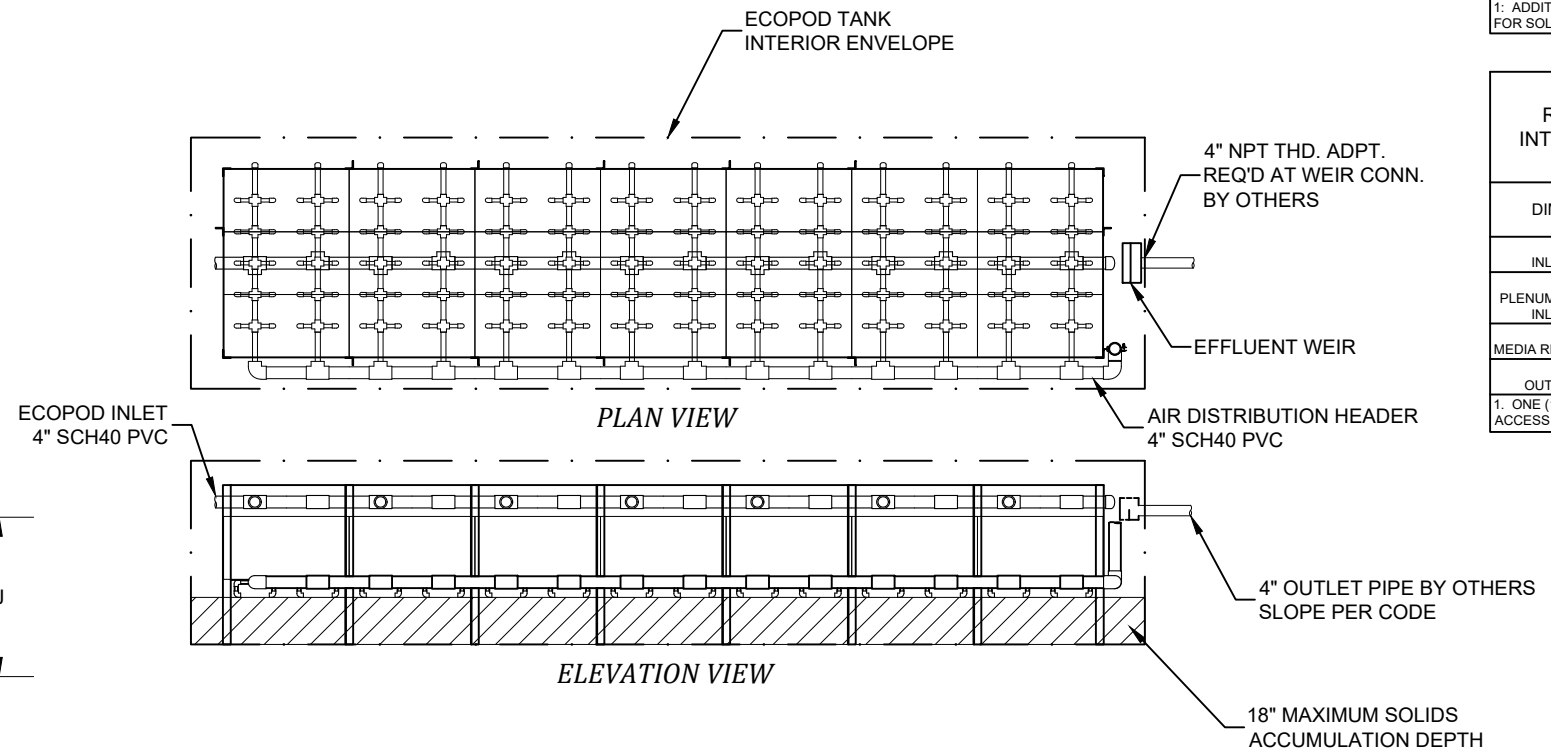

LAYOUT 3

NO.	DATE	INITIALS	DESCRIPTION


Delta Treatment Systems, LLC
An Infiltrator Water Technologies Company

COPYRIGHT (C) 2021 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF DTS. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.

DELTA ECOPOD E1000S
STANDARD DESIGN FOR BOD REDUCTION

GENERAL ARRANGEMENT
LAYOUT DIMENSIONS

HORIZ. SCALE N/A	PROJECT NO. N/A
VERT. SCALE N/A	DATE 05/19/2021
DRAWN BY CGK	DESIGNED BY AOB
DRAWING NO. C1.1	SHEET NO. 01 of 02

C:\Users\Ave\OneDrive\Desktop\Drawings\ECOPOD\ECOPOD STANDARD COMMERCIAL WORK IN PROGRESS\Standard Commercial ECOPOD Drawings\WIP Rev A.dwg