- GENERAL NOTES

 1. THE DRAWINGS DEPICTED HEREIN REPRESENT PRELIMINARY LAYOUTS OF A WASTEWATER TREATMENT SYSTEM CAPABLE OF TREATING THE DOMESTIC WASTE CONSTITUENTS NOTED
- IN TABLE 1 ECOPOD REACTOR BOX SHALL BE CONSTRUCTED OF AISI 304/304L STAINLESS STEEL.

 TANK MATERIAL SHALL BE SINGLE WALL FIBERGLASS REINFORCED PLASTIC (FRP) PER ASTM
- DA097.

 4. BLOWERS, WEIRS, CONTROL PANELS, AND VARIOUS SMALL PARTS WILL BE SHIPPED UNASSEMBLED AND SECURELY PACKAGED, TO BE INSTALLED BY CONTRACTOR.

 5. SEE INSTALLATION GUIDE FOR INSTALLATION DETAILS.

 6. CONTACT AN IWT/DELTA REPRESENTATIVE REGARDING DEVIATIONS FROM THESE STANDARDS.

TABLE 1 PROCESS PARAMETERS DELTA E600D			
PARAMETER	MINIMUM	MAXIMUM	
AVERAGE DAILY FLOW	-	6,000 GPD	
PEAK DAILY FLOW	-	9,000 GPD	
INFLUENT BOD ₅	-	15 LB/DAY	
AIR TEMPERATURE	-	115 °F	
WATER TEMPERATURE	68 °F	68 °F	
RELATIVE HUMIDITY	10%	90%	
SITE ELEVATION	0 FT AMSL	3,000 FT AMSL	

	TABLE 2 AIR DEMAND	
PARAMETER	UP TO 1,000 FT AMSL	1,000 TO 3,000 FT AMSL
STANDARD AIRFLOW	73 SCFM	85 SCFM
SITE AIR REQUIREMENT	82 ICFM	102 ICFM
BLOWER INLET AIR	116 ICFM	116 ICFM
AIR HEADER SIZE	3 IN	3 IN
MIN. TANK VENT X-SECT. AREA	47.7 IN ² 2 EA 6" OR 1 EA 8"	47.7 IN ² 2 EA 6" OR 1 EA 8"
BLOWER SELECTION	FPZ SCL K05-MS	FPZ SCL K05-MS
NOISE LEVEL	70.8 dB(A)	70.8 dB(A)
AIR TEMPERATURE RISE ¹	33 F (18.3 C)	33 F (18.3 C)
BLOWER INLET DIAMETER	2 IN NPT	2 IN NPT
BLOWER OUTLET DIAMETER	2 IN NPT	2 IN NPT
MOTOR POWER RATING ²	3 HP	3 HP
OPERATING POWER	1.7 KW	1.7 KW
	AIR TEMPERATURE WHEN SPECIFYING URER CUTSHEETS FOR ADDITIONAL ELE	

TABLE 3 STANDARD EQUIPMENT LIST			
DESCRIPTION	QTY	MAKE	MODEL
ECOPOD REACTOR	1	DELTA	E600D
BLOWER	1	FPZ	PER TABLE 2
CONTROL PANEL	1	DELTA	PER DESIGN
24" S.S. EFFI LIENT WEIR	1	DELTA	TROUGH-3.0

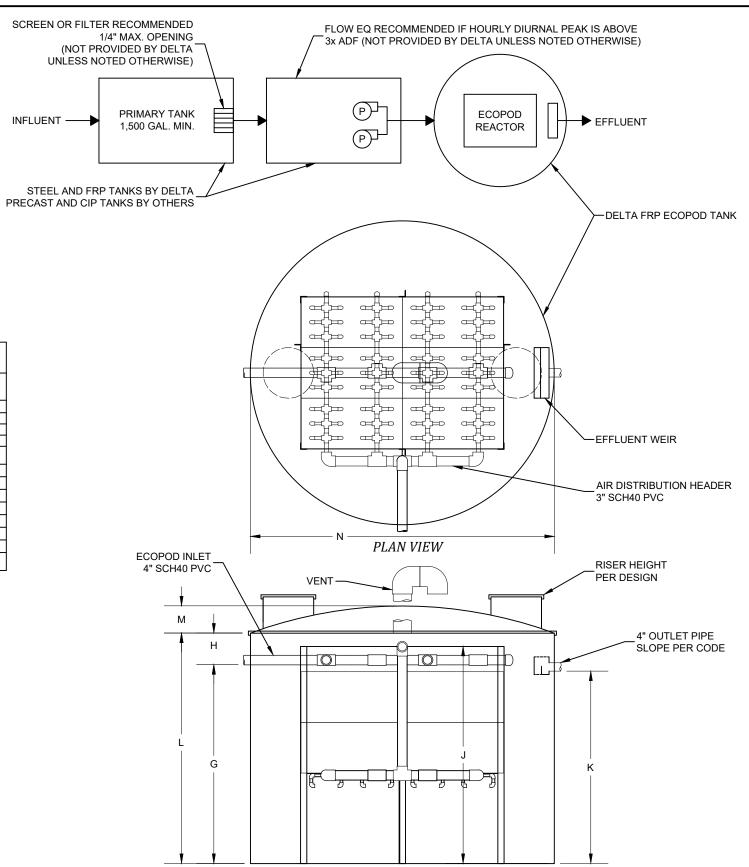


TABLE 4 (NOT APPLICABLE) MINIMUM ECOPOD REACTOR DIMENSIONS AIR HEADER CL DIM SITE ELEVATION OVERALL OVERALL LAYOUT LENGTH WIDTH IN CM СМ IN CM INTENTIONALLY LEFT BLANK.

TABLE 5 (NOT APPLICABLE) RECOMMENDED ECOPOD TANK INTERIOR ENVELOPE DIMENSIONS		
DIMENSION	IN	СМ
C VESSEL FRONT SPACE		
D VESSEL REAR SPACE		
E AIR HEADER SIDE INSIDE SPACE		
F NO HEADER SIDE INSIDE SPACE		
INTENTIONALLY LEFT BLANK.		

TABLE 6 REQUIRED ECOPOD TANK INTERIOR ENVELOPE MINIMUM DIMENSIONS			
DIMENSION	IN	СМ	
G 92 234			
H PLENUM SPACE ABOVE INLET INVERT	10	25	
J MEDIA REACTOR HEIGHT	101	257	
K OUTLET INVERT 89 226			
ONE (1 EA.) INLET AND ONE (1 EA.) OUTLET ACCESS RISER REQUIRED, 24" DIA MINIMUM.			

TABLE 7 VC ECOPOD TANK EXTERIOR DIMENSIONS			
DIMENSION	IN	СМ	
L = G + H TANK WALL HEIGHT	102	259	
M TANK DOME HEIGHT	12	30	
N TANK DIAMETER ¹	144	366	
1. PIPE PENETRATIONS EXTEND 3 IN. FROM TANK WALL			

	DESCRIPTION	INITIALS	DATE	NO.
1				
1				
COPYRIGHT (C) 2021 D				
OF DTS. NO PART OF WHOLE OR IN PART, V				
AND IS FOR BUDGET				
APPLICABILI				



ELEVATION VIEW

Delta Treatment Systems, LLC

DELTA ECOPOD E600D-VC STANDARD DESIGN FOR BOD REDUCTION

HORIZ, SCALE	PROJECT NO.
N/A	N/A
VERT. SCALE	DATE
N/A	07/21/2021
DRAWN BY	DESIGNED BY
CGK	AOB
DRAWING NO.	SHEET NO.
C1.0	01 of 01

An Infiltrator Water Technologies Company	
21 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN IT, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS OFFICIALLY OF PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMING THE	GENERAL ARRANGEMENT
DILITY TO A SPECIFIC DROJECT IS AT THE SOLE DISCRETION OF THE LISER AND/OR THE ENGINEER OF RECORD	