


SEPTIC TANK AND PUMP CHAMBER INFILTRATOR SYSTEMS INC. TYPICAL TANK DETAIL

(NOT TO SCALE)

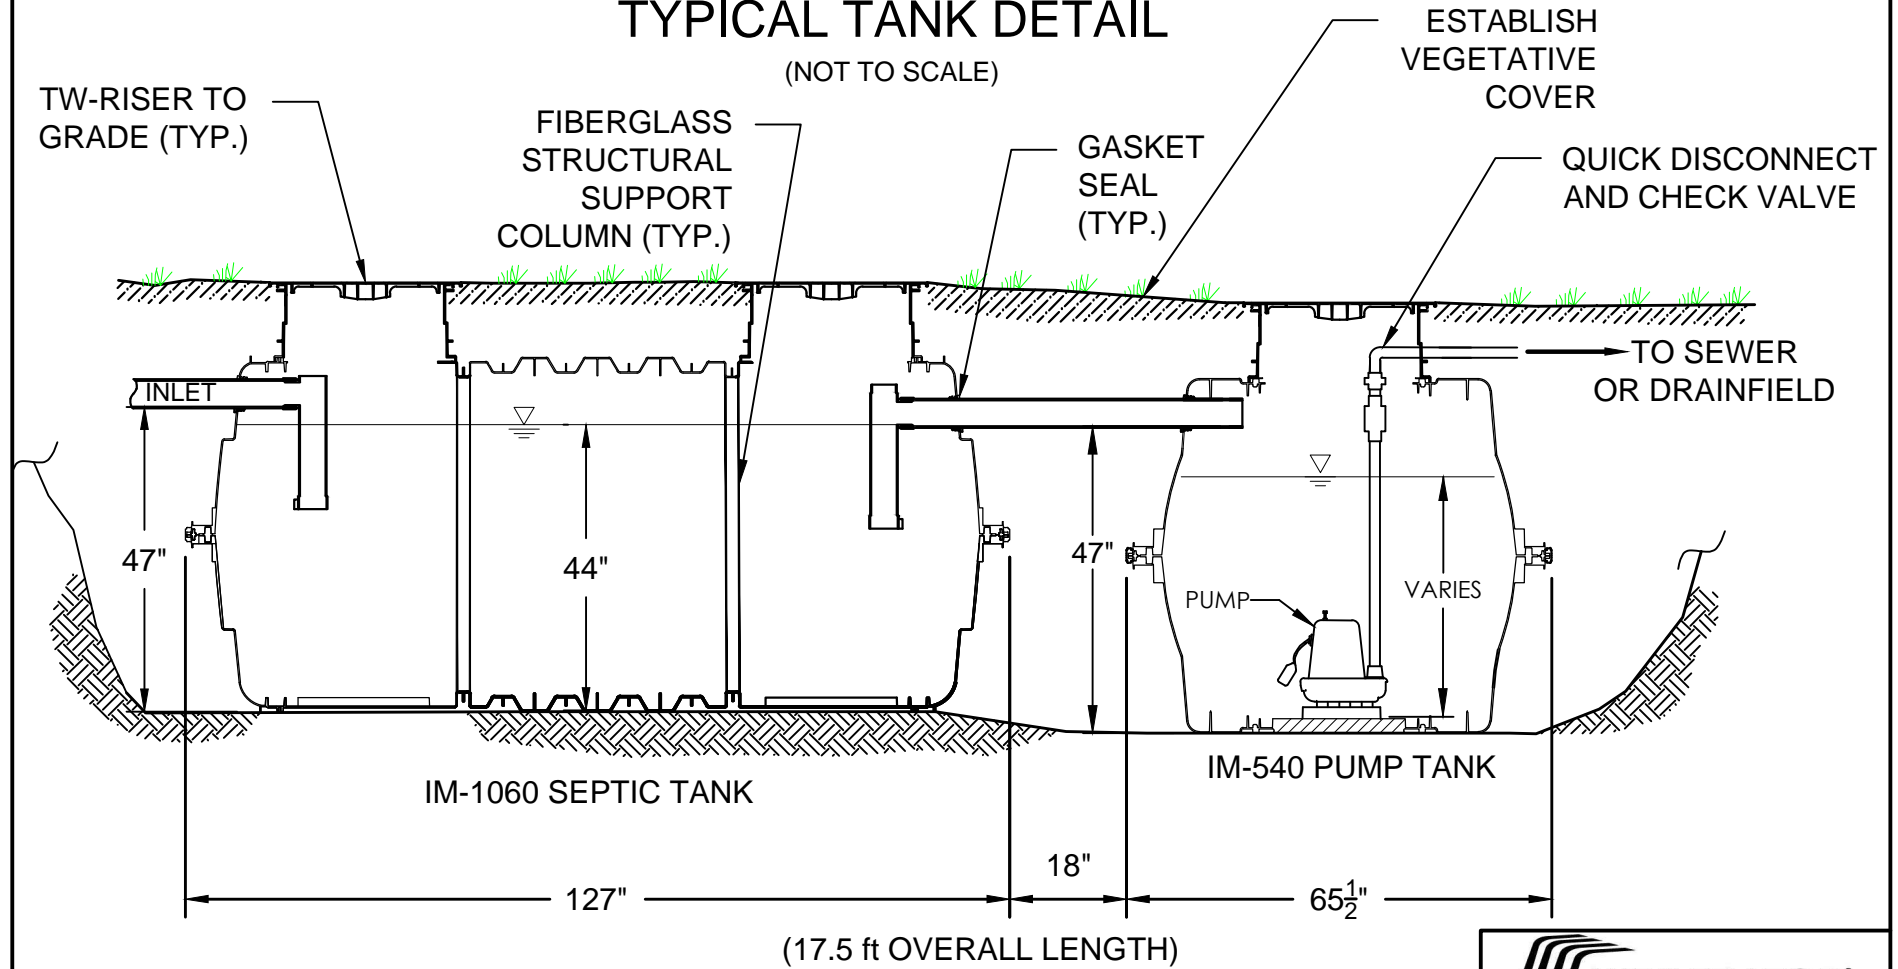

NOTES:

1. THE DROP IN THE SEPTIC TANK IS SHOWN AS 3", DESIGN MAY VARY.
2. THE PUMP TANK CAN BE INSTALLED WITH A 44" INVERT TO KEEP THE EXCAVATION HOLE THE SAME ELEVATION, DESIGN CAN VARY.
3. SCHEMATIC ONLY, INSTALL PER INSTALLATION INSTRUCTIONS



INFILTRATOR SYSTEMS INC.
6 Business Park Rd. Old Saybrook, CT 06475
(800) 221-4436

IM-1060 TANK WITH
IM-540 PUMP TANK

Drawn by: DGC	Drawing No. 1	Date: 3/13/2014	
Scale: NOT TO SCALE	Checked by: DFH	Sheet: 1 of 1	