


1. NOTES:
2. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
3. OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.
4. INSTALL TANKS PER INSTALLATION INSTRUCTIONS

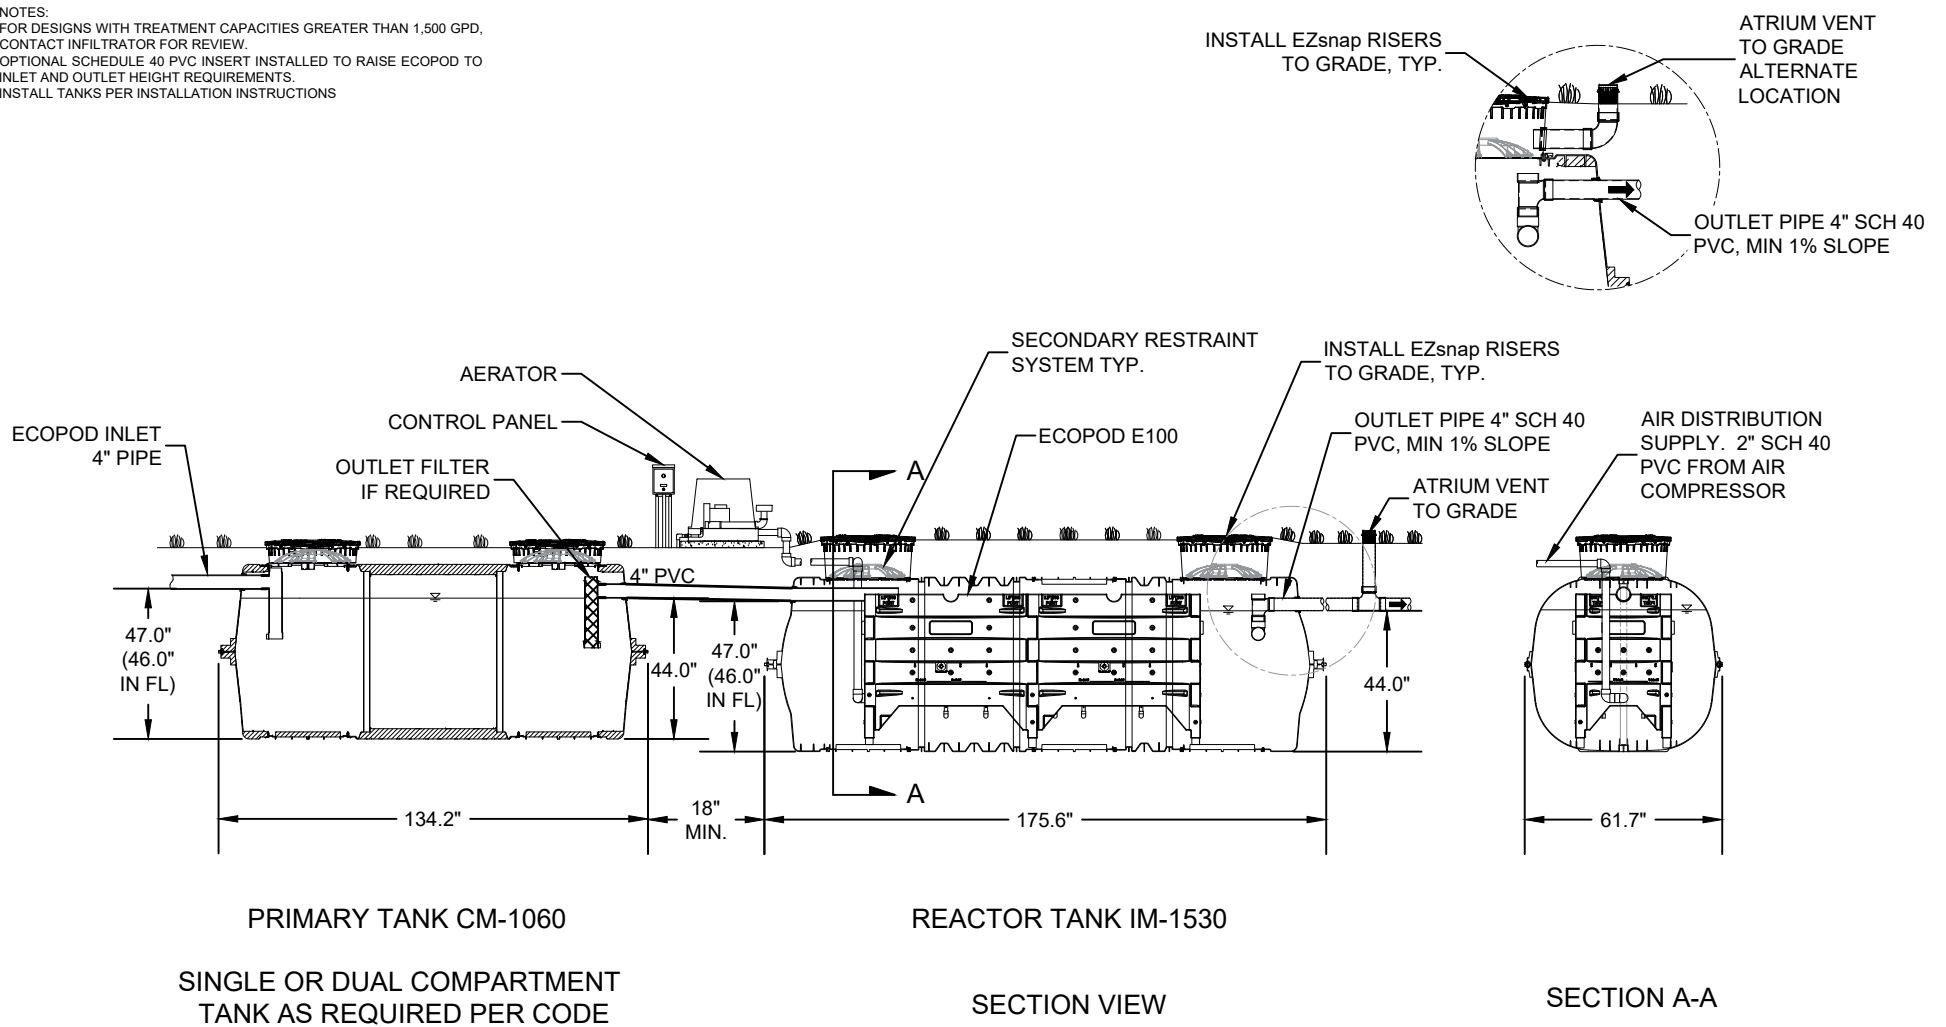

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E100N
AERATOR	IWT MODEL K03
MOTOR FULL LOADS AMP	7.1
MEASURED OPERATING WATTS	475
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E100N
TREATMENT CAPACITY (GPD)	1,000
MIN. PRIMARY TANK VOLUME (GAL.)	1,000
REACTOR TANK VOLUME (GAL.)	1,405
MEDIA SIZE	8' X 2' X 2'
AIR REQUIREMENTS	24 CFM



INFILTRATOR WATER TECHNOLOGIES, LLC
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
 WWW.INFILTRATORWATER.COM
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

ECOPOD-N[®]

E100NIM

PART NO.
E100N
 DATE
 10/16/2025
 SCALE
1:60
 SHEET NO.
01 of 01