


- NOTES:
1. INSTALL TANK PER PRECASTER INSTRUCTIONS.
 2. IF PRECAST DIMENSIONS ARE OUTSIDE THE MINIMUM DIMENSIONS, CONTACT INFILTRATOR FOR REVIEW.
 3. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
 4. OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

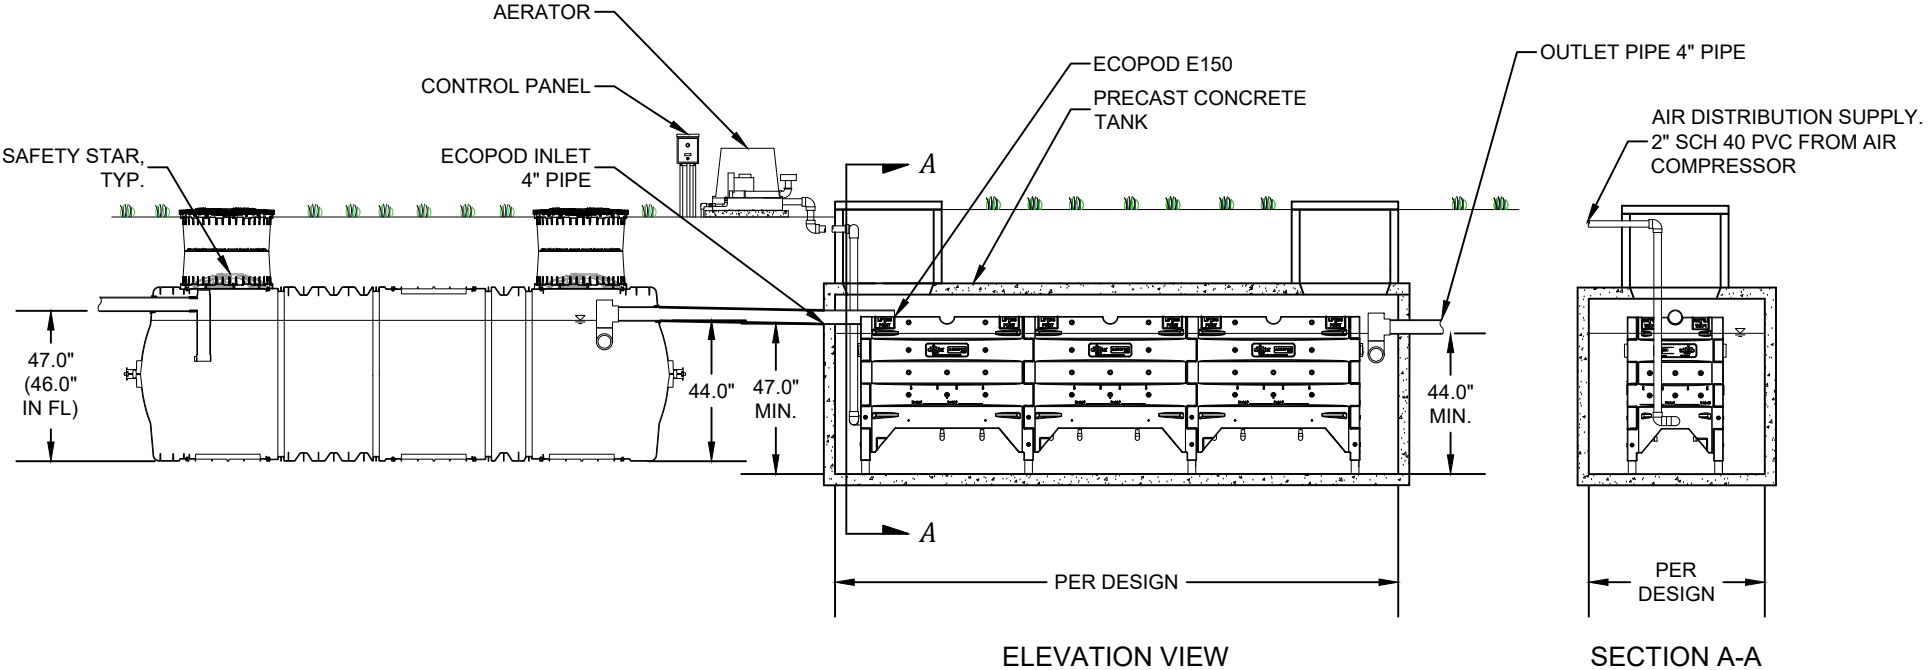

ELECTRICAL REQUIREMENTS	
TREATMENT PLANT	E150N
AERATOR	IWT MODEL K03
MOTOR FULL LOADS AMP	7.1
MEASURED OPERATING WATTS	475
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS	
TREATMENT PLANT	E150N
TREATMENT CAPACITY (GPD)	1,500
MIN. PRIMARY TANK VOLUME (GAL.)	1,500
REACTOR TANK VOLUME (GAL.)	2,100
MEDIA SIZE	12" X 2' X 2'
AIR REQUIREMENTS	36 CFM

 INFILTRATOR WATER TECHNOLOGIES, LLC 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475 WWW.INFILTRATORWATER.COM PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM	 E150NCA	PART NO. E150N
		DATE 04/24/2025
		SCALE 1:60
		SHEET NO. 01 of 01