




NOTES:

1. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
2. OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

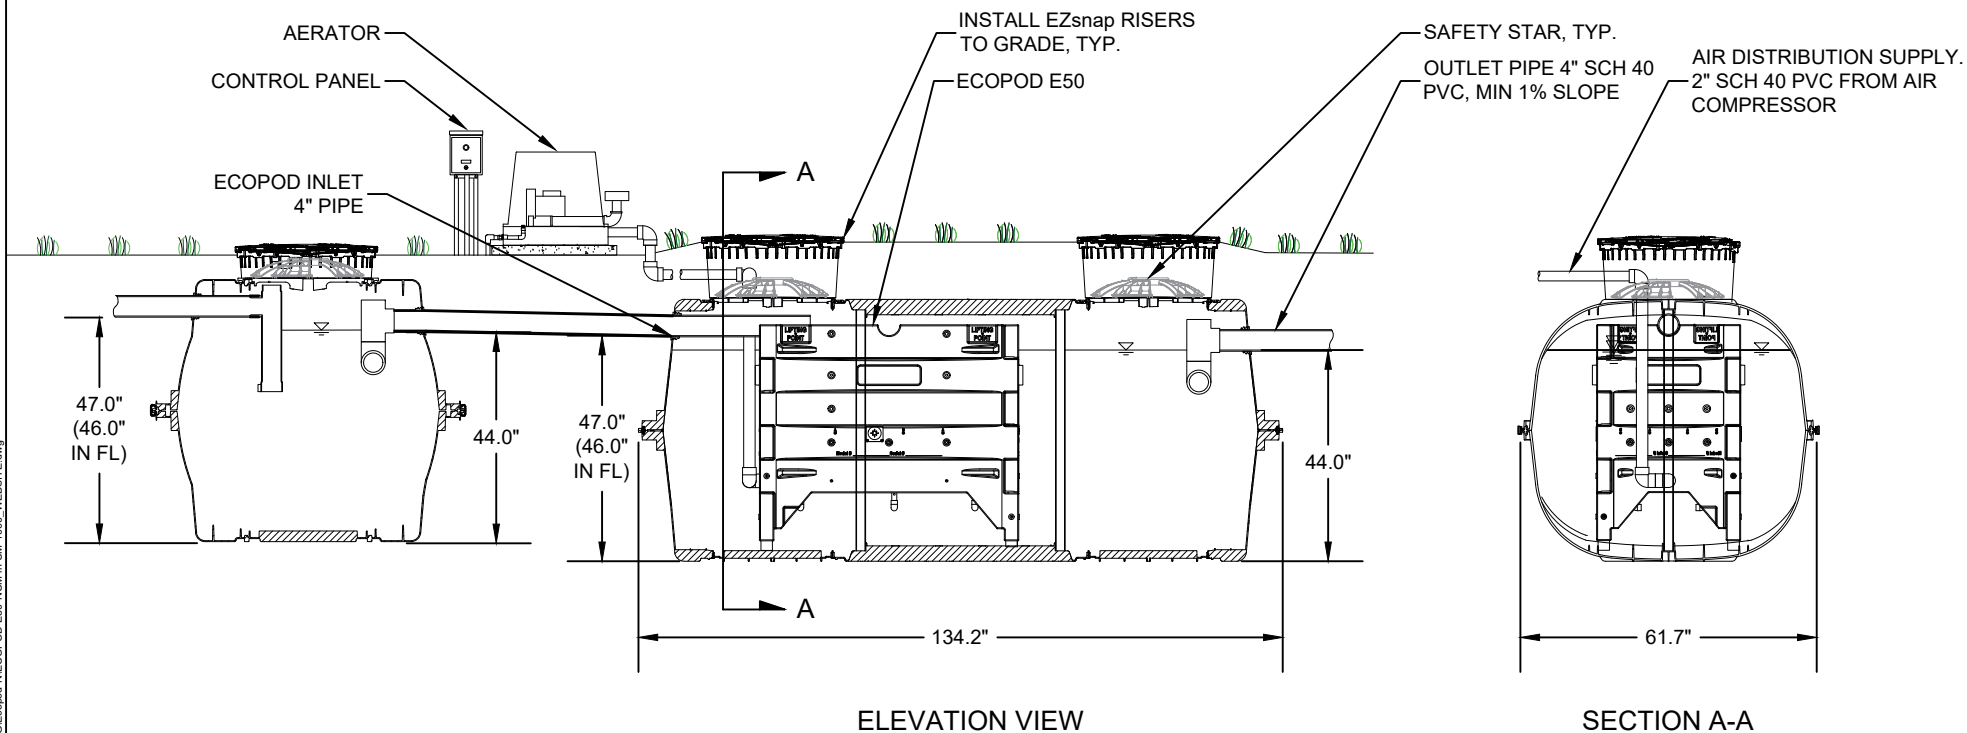

ELECTRICAL REQUIREMENTS	
TREATMENT PLANT	E50N
AERATOR	IWT MODEL 06
MOTOR FULL LOADS AMP	3.5
MEASURED OPERATING WATTS	185
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS	
TREATMENT PLANT	E50N
TREATMENT CAPACITY (GPD)	500
MIN. PRIMARY TANK VOLUME (GAL.)	500
REACTOR TANK VOLUME (GAL.)	710
MEDIA SIZE	4' X 2' X 2'
AIR REQUIREMENTS	12 CFM

 <p><b>Infiltrator</b> Water Technologies Part of <b>ADS</b></p>		PART NO.
		E50N
<p>INFILTRATOR WATER TECHNOLOGIES, LLC 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475 WWW.INFILTRATORWATER.COM PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM</p>	<p>E50NCM</p>	DATE
		04/24/2025
		SCALE
		1:40
		SHEET NO.
		01 of 01