


- NOTES:
1. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
 2. INSTALL TANKS PER INSTALLATION INSTRUCTIONS

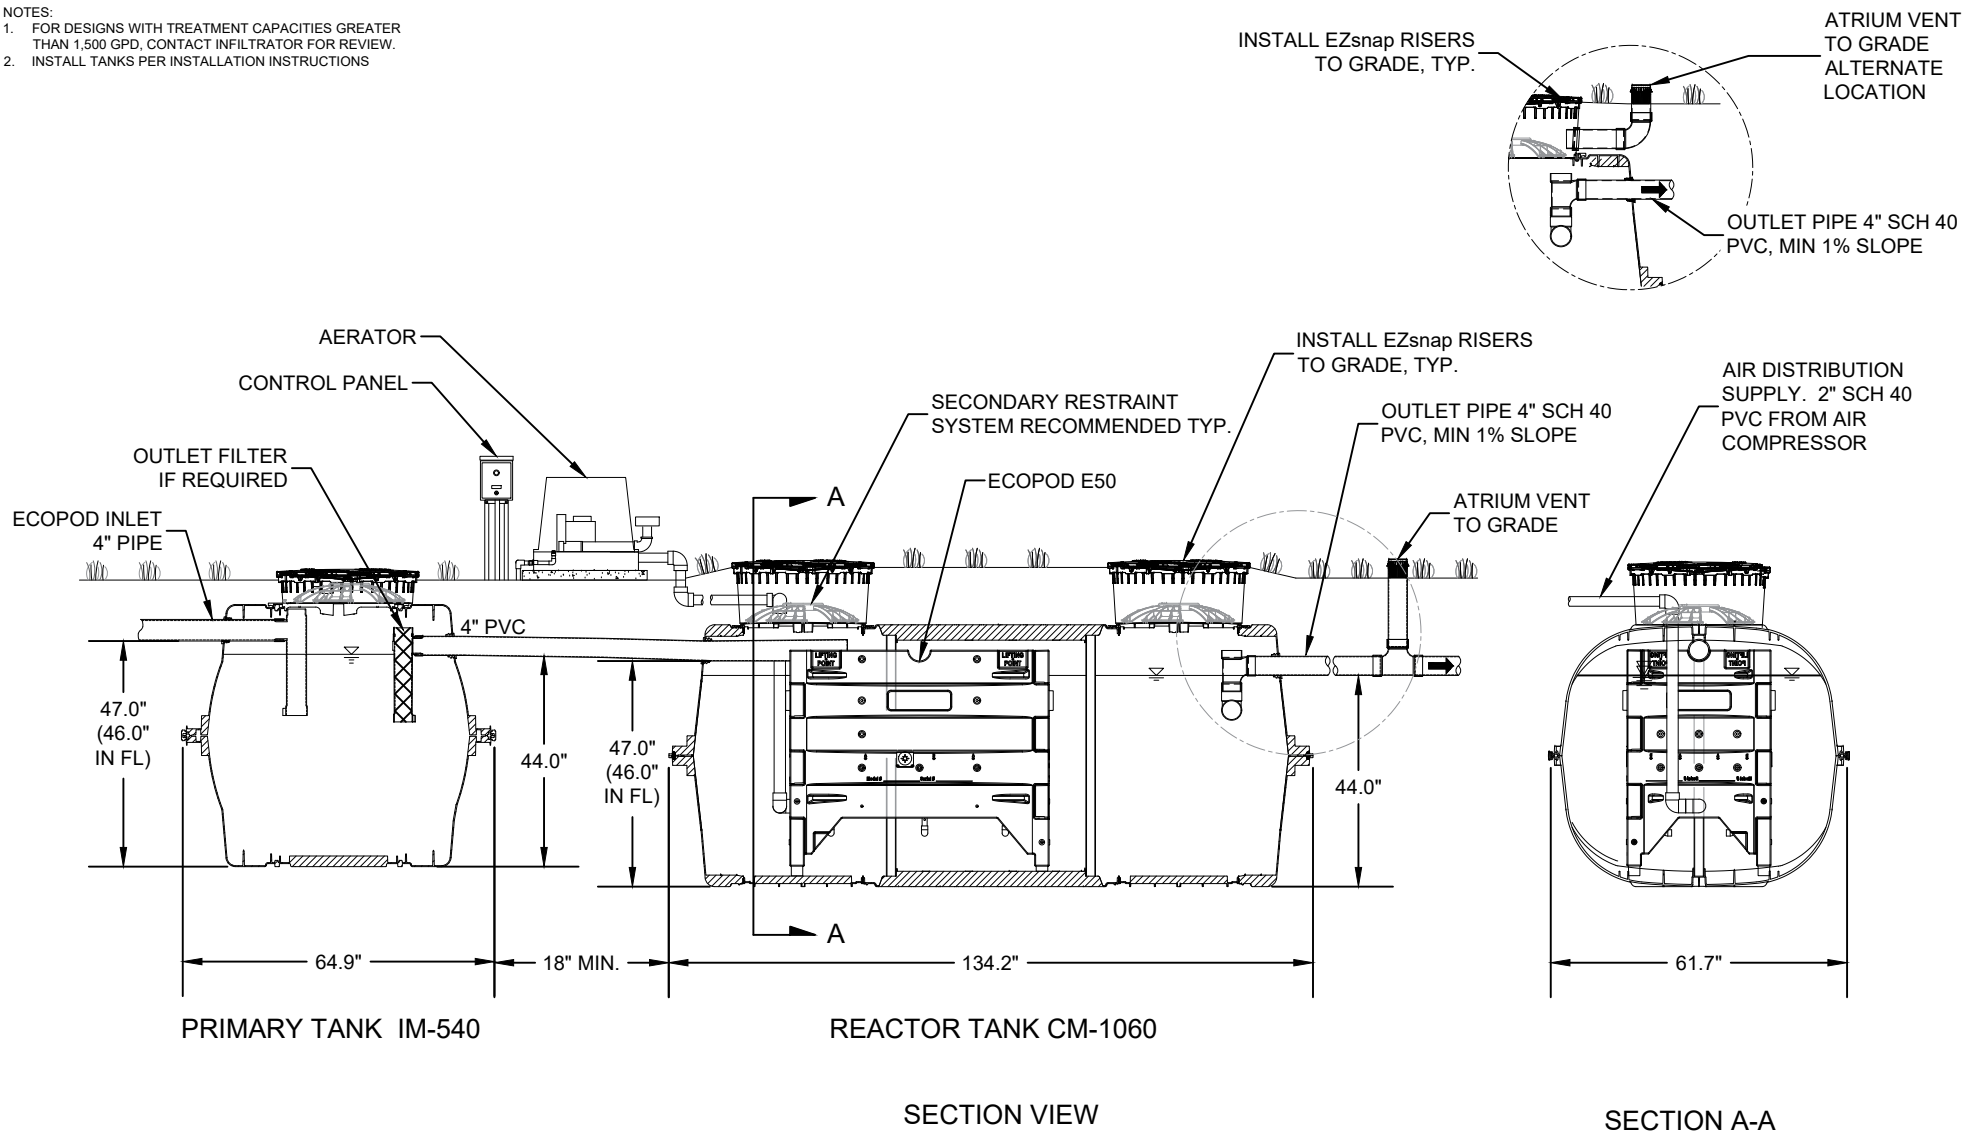

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E50N
AERATOR	IWT MODEL 06
MOTOR FULL LOADS AMP	3.5
MEASURED OPERATING WATTS	185
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E50N
TREATMENT CAPACITY (GPD)	500
MIN. PRIMARY TANK VOLUME (GAL.)	500
REACTOR TANK VOLUME (GAL.)	710
MEDIA SIZE	4\" X 2\" X 2\"
AIR REQUIREMENTS	12 CFM



Part of **ADS**

INFILTRATOR WATER TECHNOLOGIES, LLC

4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475

WWW.INFILTRATORWATER.COM

PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

ECOPOD-N[®]

E50NCM

PART NO.

E50N

DATE

10/10/2025

SCALE

1:40

SHEET NO.

01 of 01