


NOTES:

1. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
2. INSTALL TANKS PER INSTALLATION INSTRUCTIONS

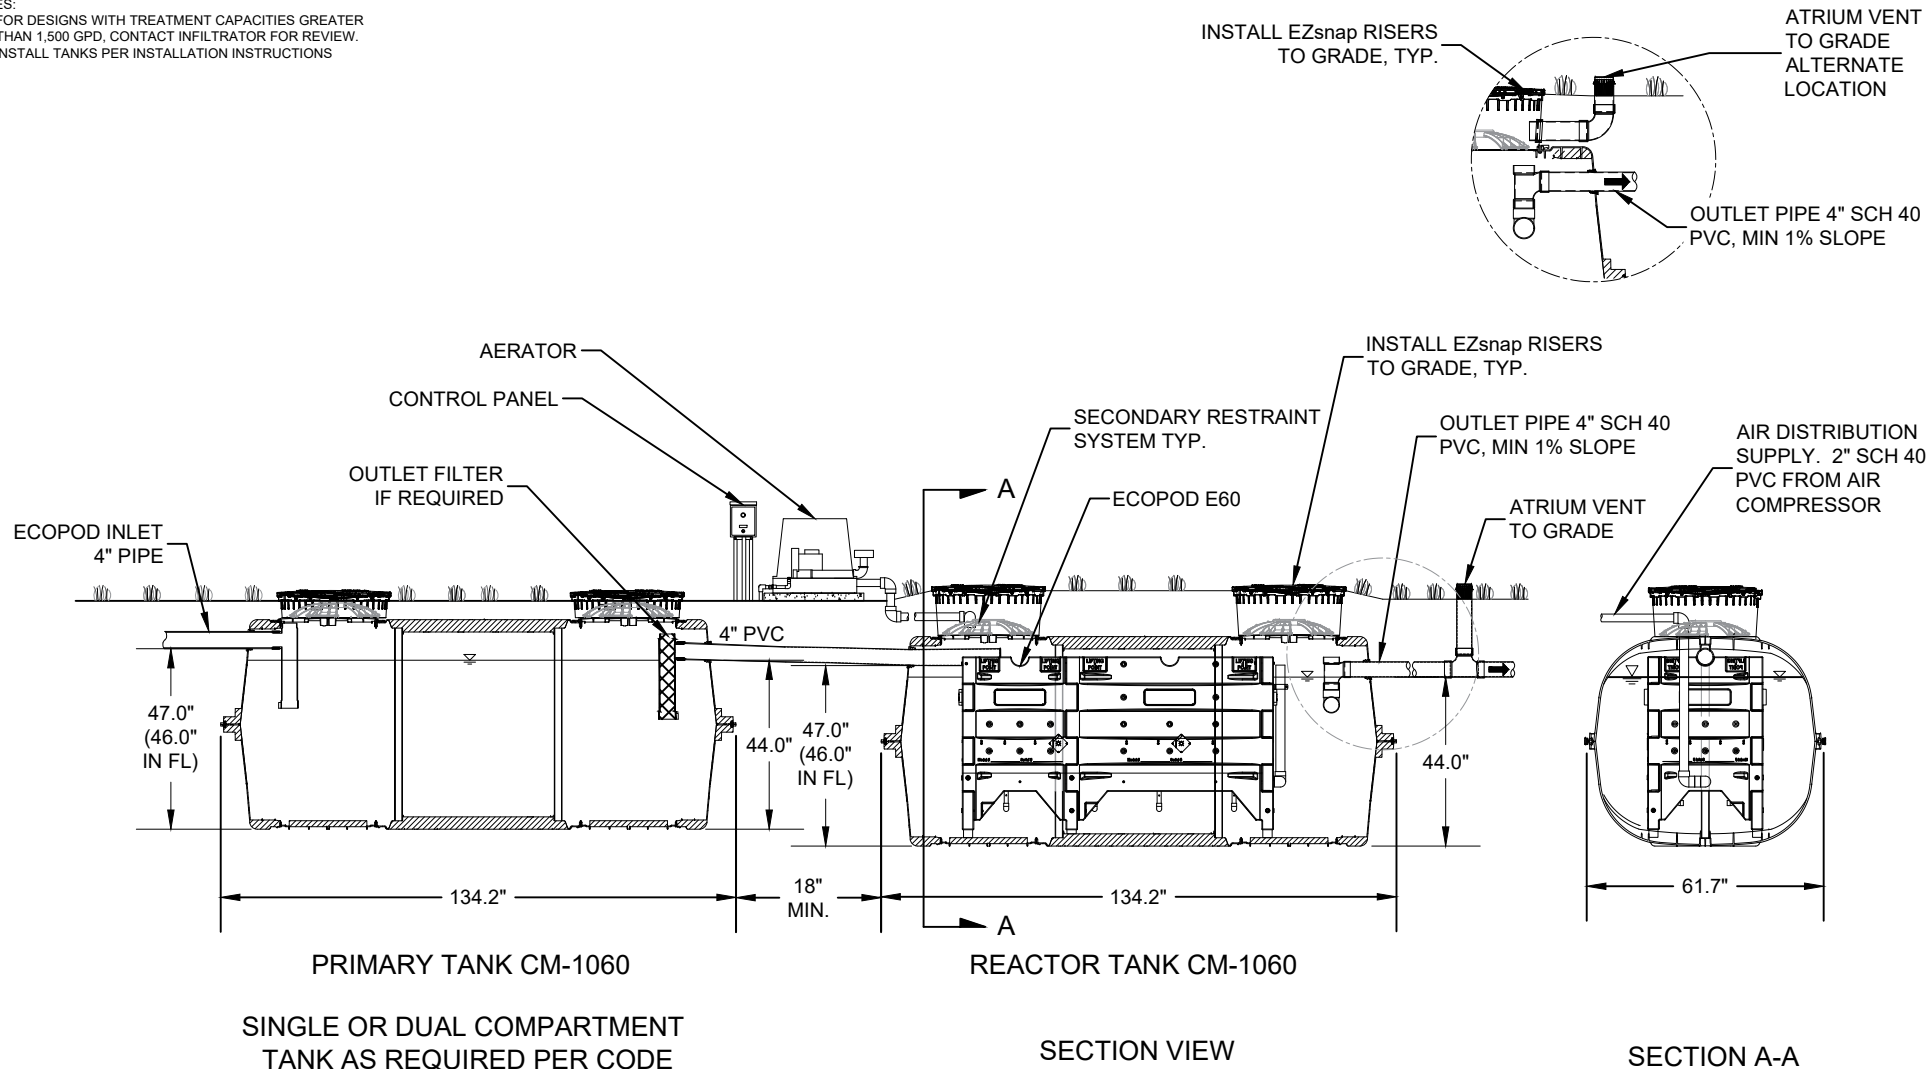

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E60N
AERATOR	IWT MODEL 06
MOTOR FULL LOADS AMP	4.7
MEASURED OPERATING WATTS	280
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E60N
TREATMENT CAPACITY (GPD)	600
MIN. PRIMARY TANK VOLUME (GAL.)	600
REACTOR TANK VOLUME (GAL.)	916
MEDIA SIZE	6' X 2' X 2'
AIR REQUIREMENTS	14.4 CFM



INFILTRATOR WATER TECHNOLOGIES, LLC
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
 WWW.INFILTRATORWATER.COM
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

ECOPOD-N[®]

E60NCM

PART NO.
E60N
 DATE
 10/10/2025
 SCALE
1:40
 SHEET NO.
01 of 01