


- NOTES:
1. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
 2. INSTALL TANKS PER INSTALLATION INSTRUCTIONS

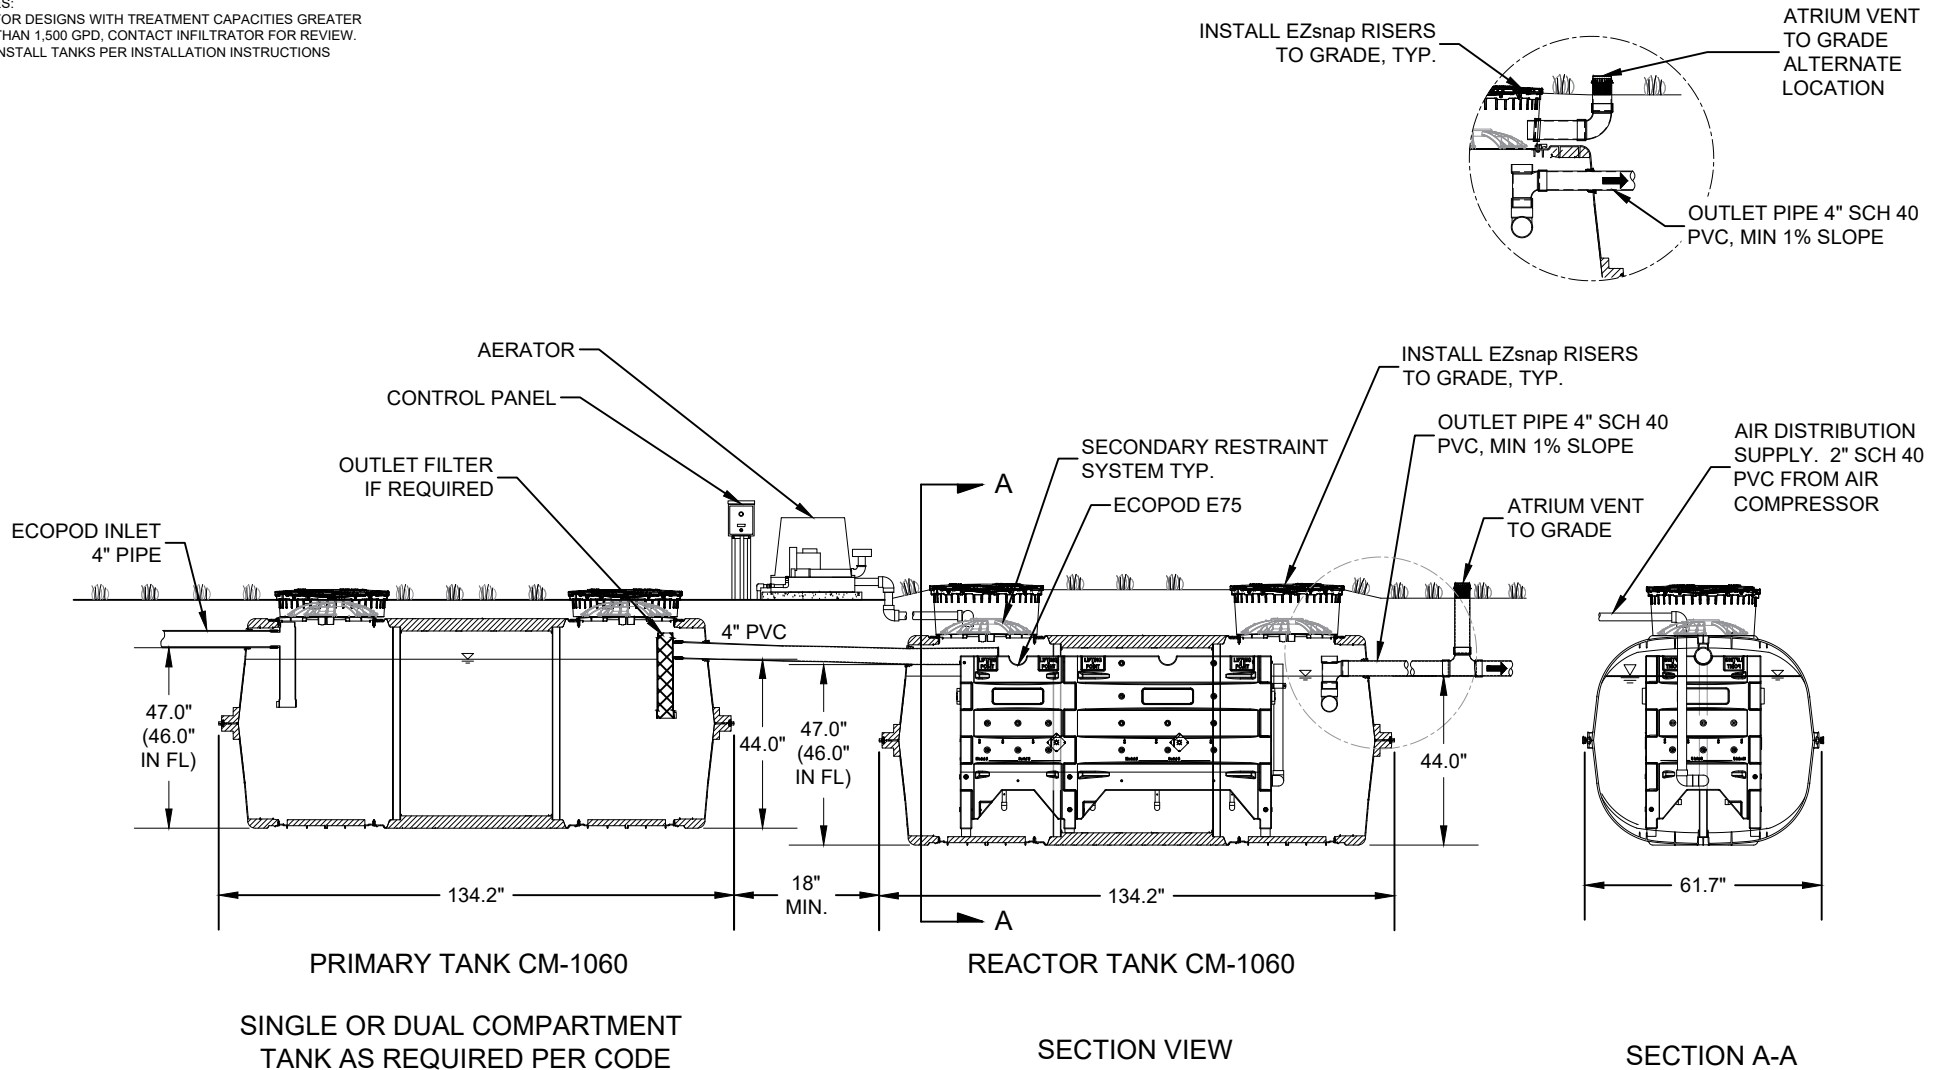

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E75N
AERATOR	IWT MODEL 06
MOTOR FULL LOADS AMP	4.7
MEASURED OPERATING WATTS	280
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E75N
TREATMENT CAPACITY (GPD)	750
MIN. PRIMARY TANK VOLUME (GAL.)	750
REACTOR TANK VOLUME (GAL.)	916
MEDIA SIZE	6\" X 2\" X 2\"
AIR REQUIREMENTS	18 CFM



INFILTRATOR WATER TECHNOLOGIES, LLC
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
 WWW.INFILTRATORWATER.COM
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

ECOPOD-N[®]

E75NCM

PART NO.
E75N
 DATE
 10/10/2025
 SCALE
1:50
 SHEET NO.
01 of 01