



DELTA TREATMENT SYSTEMS, LLC
ECOPOD E50-NIM
INSTALLED WITH IM-1060 TANK
TYPICAL CROSS SECTION DETAIL
(NOT TO SCALE)

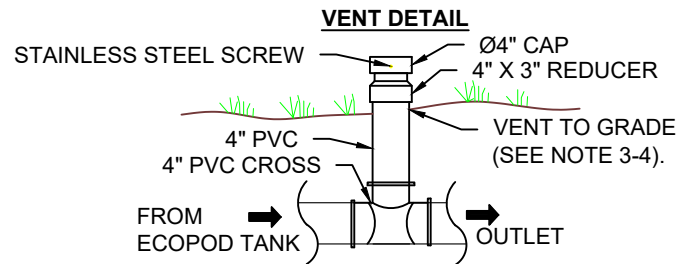

NOTES:

1. INSTALL TANK PER INSTALLATION INSTRUCTIONS.
2. FOR STATE SPECIFIC DRAWINGS PLEASE CONTACT DELTA TREATMENT SYSTEMS, LLC.
3. AIR COMPRESSOR INSTALLED WITHIN 100 FT OF THE TANK.
4. AIR COMPRESSOR SHOULD BE LOCATED ABOVE FLOOD LEVELS ON A SOLID BASE.
4. VENT MUST BE LOCATED ABOVE FINAL GRADE TO AVOID INFILTRATION. SECURE CAP ON VENT WITH STAINLESS STEEL SCREW TO PREVENT UNAUTHORIZED ACCESS.

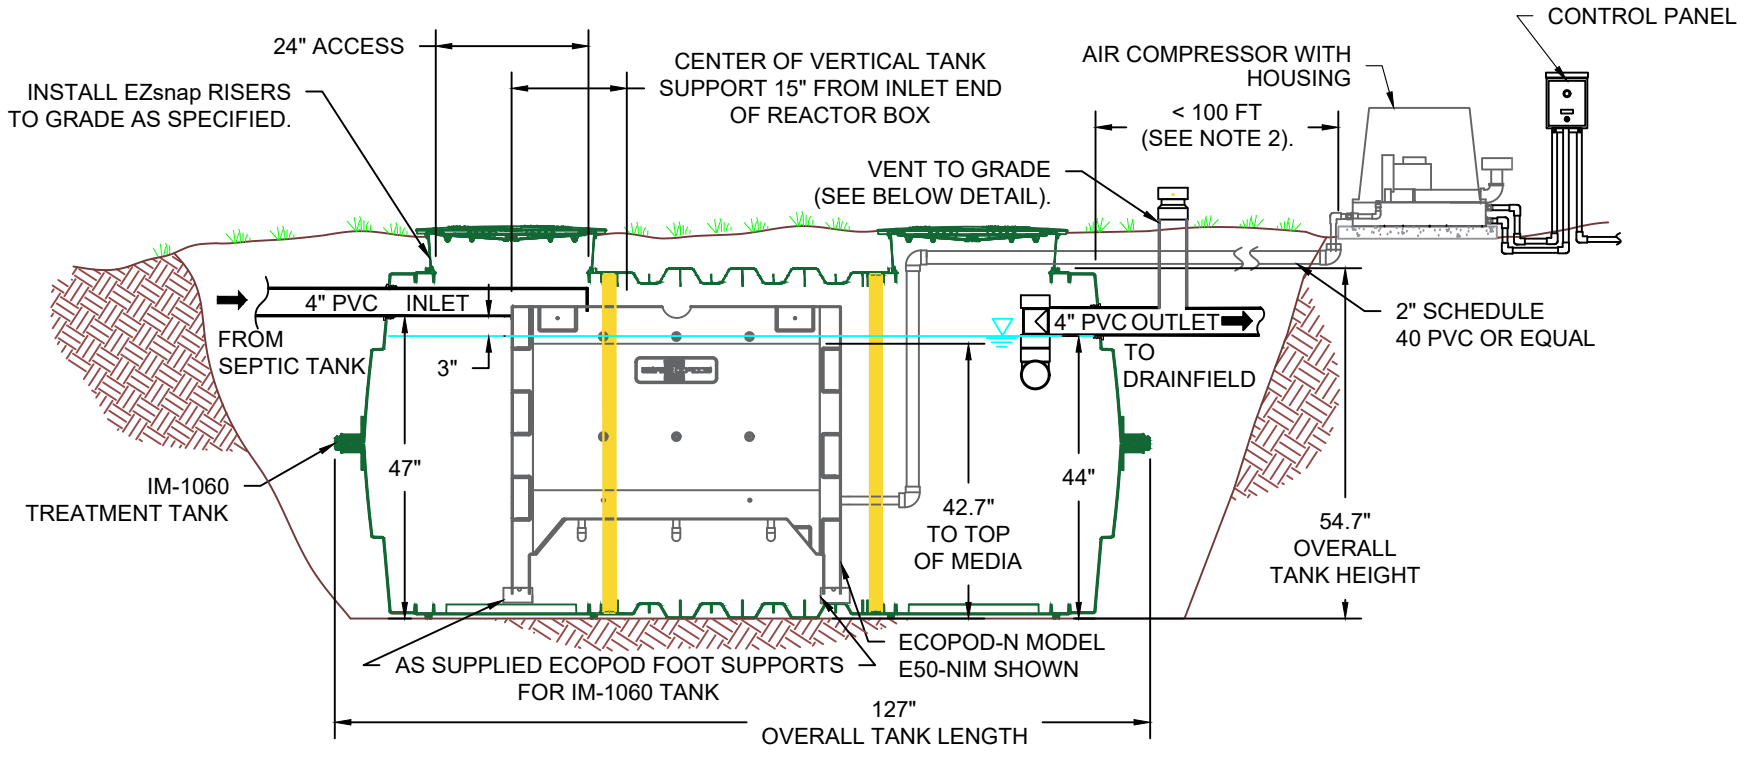

DELTA TREATMENT SYSTEMS, LLC.
 9125 Comar Dr. Walker, LA 70785
 (800) 219-9183

ECOPOD E-50NIM
INSTALLED WITH IM-1060 TANK
TYPICAL CROSS SECTION DETAIL

Drawn by: RYAN D.	Date: 7/17/2019
Scale: NOT TO SCALE	Checked by: DFH
Sheet: 1 OF 1	

Q:\Technical Resources New\02-151_PRODUCT\025 - Delta Products\ECOPOD\ECOPOD E-50 in IM-1060 Typical Cross Section Detail-Model.dwg