



- GENERAL NOTES
- THE DRAWINGS DEPICTED HEREIN REPRESENT PRELIMINARY LAYOUTS OF A WASTEWATER TREATMENT SYSTEM CAPABLE OF TREATING THE DOMESTIC WASTE CONSTITUENTS NOTED IN TABLE 1.
 - ECOPOD REACTOR BOX SHALL BE CONSTRUCTED OF AISI 304/304L STAINLESS STEEL.
 - TANK MATERIAL OPTIONS:
 - CARBON STEEL PER ASTM A36 w/COATING PER DELTA STANDARDS,
 - FIBERGLASS REINFORCED PLASTIC (FRP) (NOT ALL MODELS),
 - PRECAST CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS,
 - CAST-IN-PLACE CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 - BLOWERS, WEIRS, CONTROL PANELS, AND VARIOUS SMALL PARTS WILL BE SHIPPED UNASSEMBLED AND SECURELY PACKAGED, TO BE INSTALLED BY CONTRACTOR.
 - SEE INSTALLATION GUIDE FOR INSTALLATION DETAILS.
 - CONTACT AN IWT/DELTA REPRESENTATIVE REGARDING DEVIATIONS FROM THESE STANDARDS.

| PARAMETER | MINIMUM | MAXIMUM |
|---------------------------|-----------|---------------|
| AVERAGE DAILY FLOW | - | 2,000 GPD |
| PEAK DAILY FLOW | - | 3,000 GPD |
| INFLUENT BOD ₅ | - | 5 LB/DAY |
| AIR TEMPERATURE | - | 115 °F |
| WATER TEMPERATURE | 68 °F | 68 °F |
| RELATIVE HUMIDITY | 10% | 90% |
| SITE ELEVATION | 0 FT AMSL | 3,000 FT AMSL |

| PARAMETER | UP TO 1,000 FT AMSL | 1,000 TO 3,000 FT AMSL |
|-----------------------------------|---------------------------------|--|
| STANDARD AIRFLOW | 24 SCFM | 28 SCFM |
| SITE AIR REQUIREMENT | 27 ICFM | 34 ICFM |
| BLOWER INLET AIR | 29 ICFM | 50 ICFM |
| AIR HEADER SIZE | 3 IN | 3 IN |
| MIN. TANK VENT X-SECT. AREA | 11.9 IN ² 1 EA 4" | 20.6 IN ² 2 EA 4" OR 1 EA 6" |
| BLOWER SELECTION | FPZ SCL R20-MD | FPZ SCL R30-MD |
| NOISE LEVEL | 68.5 dB(A) | 72.2 dB(A) |
| AIR TEMPERATURE RISE ¹ | 42 F (23.3 C) | 29 F (16.1 C) |
| BLOWER INLET DIAMETER | 1.25 IN NPT | 1.25 IN NPT |
| BLOWER OUTLET DIAMETER | 1.25 IN NPT | 1.25 IN NPT |
| MOTOR POWER RATING ² | 1.5 HP | 2 HP |
| OPERATING POWER | 0.57 KW | 0.93 KW |

1. REVIEW BLOWER DISCHARGE AIR TEMPERATURE WHEN SPECIFYING AIR MAIN PIPING MATERIAL.
2. REVIEW BLOWER MANUFACTURER CUTSHEETS FOR ADDITIONAL ELECTRICAL INFORMATION.

| DESCRIPTION | QTY | MAKE | MODEL |
|------------------------|-----|-------|-------------|
| ECOPOD REACTOR | 1 | DELTA | E200D |
| BLOWER | 1 | FPZ | PER TABLE 2 |
| CONTROL PANEL | 1 | DELTA | PER DESIGN |
| 24" S.S. EFFLUENT WEIR | 1 | DELTA | TROUGH-3.0 |

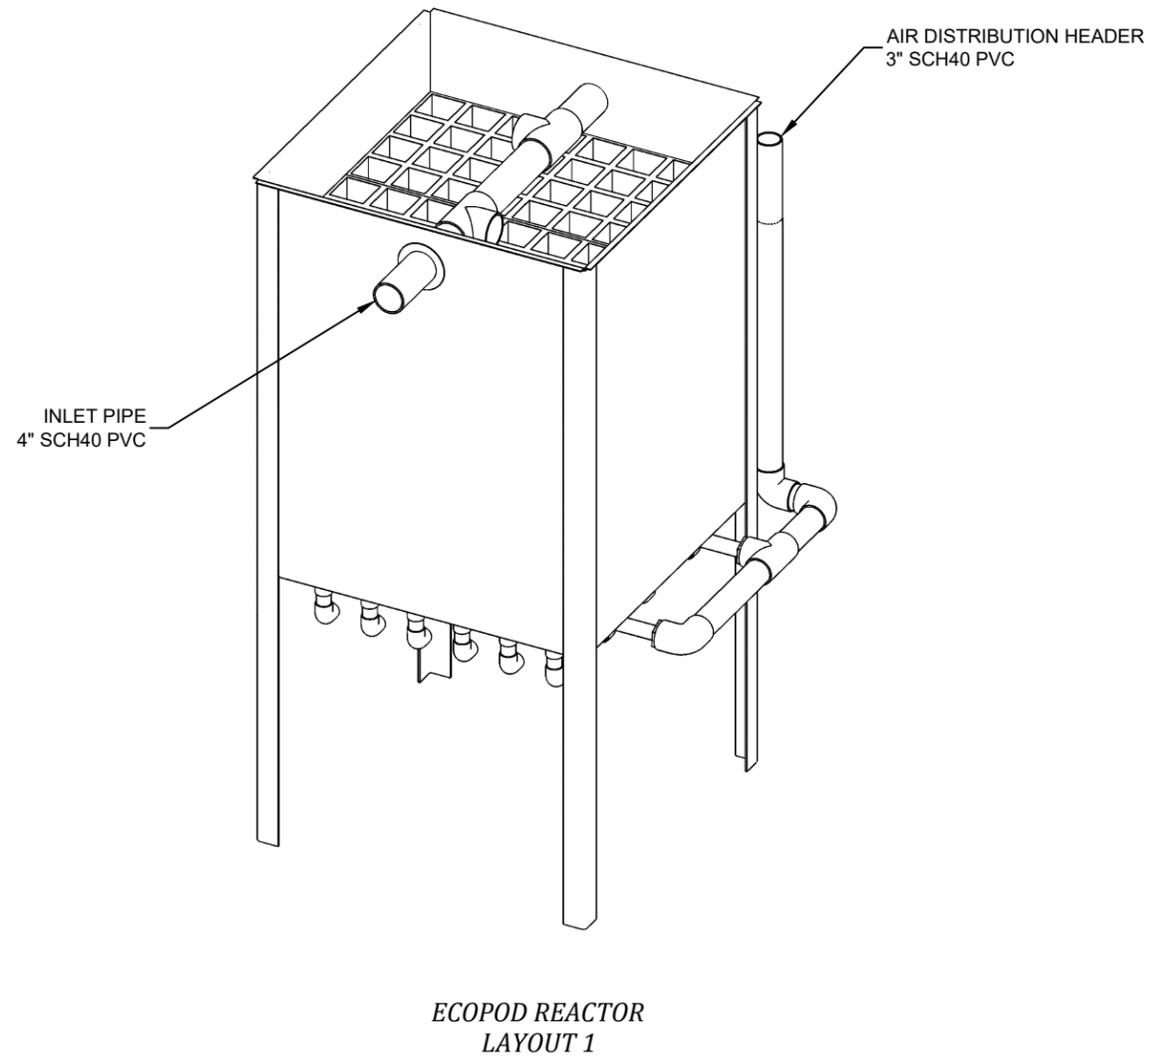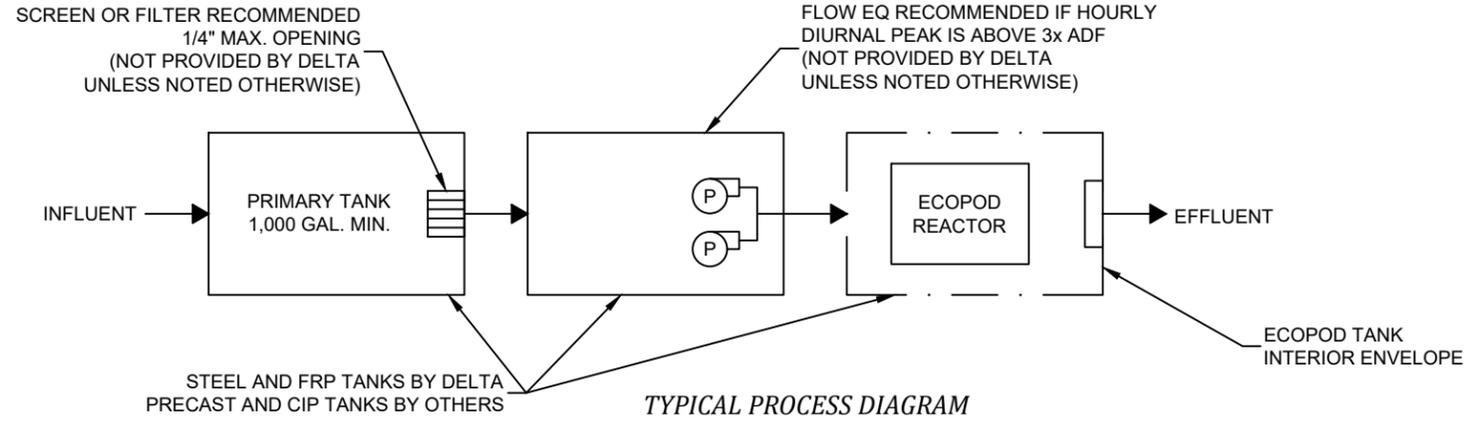

| NO. | DATE | INITIALS | DESCRIPTION |
|-----|----------|----------|----------------------|
| A | 10/12/21 | AOB | ADDED TRIMETRIC VIEW |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |


Delta Treatment Systems, LLC
 An Infiltrator Water Technologies Company

COPYRIGHT (C) 2021 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF DTS. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.

DELTA ECOPOD E200D
STANDARD DESIGN FOR BOD REDUCTION

GENERAL ARRANGEMENT
DESIGN OVERVIEW


| HORIZ. SCALE | PROJECT NO. |
|--------------|-------------|
| N/A | N/A |
| VERT. SCALE | DATE |
| N/A | 02/11/2021 |
| DRAWN BY | DESIGNED BY |
| CGK | AOB |
| DRAWING NO. | SHEET NO. |
| C1.0 | 01 of 02 |

C:\Users\kva\OneDrive\Desktop\Drawings\ECOPOD\STANDARD COMMERCIAL WORK IN PROGRESS\Standard Commercial ECOPOD Drawings\WIP Rev A.dwg

- GENERAL NOTES
1. ECOPOD REACTOR BOX SHALL BE CONSTRUCTED OF AISI 304/304L STAINLESS STEEL.
 2. TANK MATERIAL OPTIONS:
 - 2.1. CARBON STEEL PER ASTM A36 w/COATING PER DELTA STANDARDS.
 - 2.2. FIBERGLASS REINFORCED PLASTIC (FRP) (NOT ALL MODELS).
 - 2.3. PRECAST CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 - 2.4. CAST-IN-PLACE CONCRETE PER ENGINEER OF RECORD REQUIREMENTS, BY OTHERS.
 3. SEE INSTALLATION GUIDE FOR INSTALLATION DETAILS.
 4. CONTACT AN IWT/DELTA REPRESENTATIVE REGARDING DEVIATIONS FROM THESE STANDARDS.

| SITE ELEVATION | | LAYOUT ID | REACTOR WEIGHT | | A OVERALL LENGTH | | B OVERALL WIDTH | | B1 AIR HEADER CL DIM | |
|----------------|-------|-----------|----------------|-----|------------------|-----|-----------------|-----|----------------------|----|
| FT | M | | LB | KG | IN | CM | IN | CM | IN | CM |
| 0-3,000 | 0-914 | 1 | 690 | 313 | 58 | 148 | 59 | 150 | 32 | 82 |

1. SOME REACTOR LAYOUTS NOT AVAILABLE IN FIBERGLASS TANKS. CONTACT AN IWT/DELTA REPRESENTATIVE FOR DETAILS.

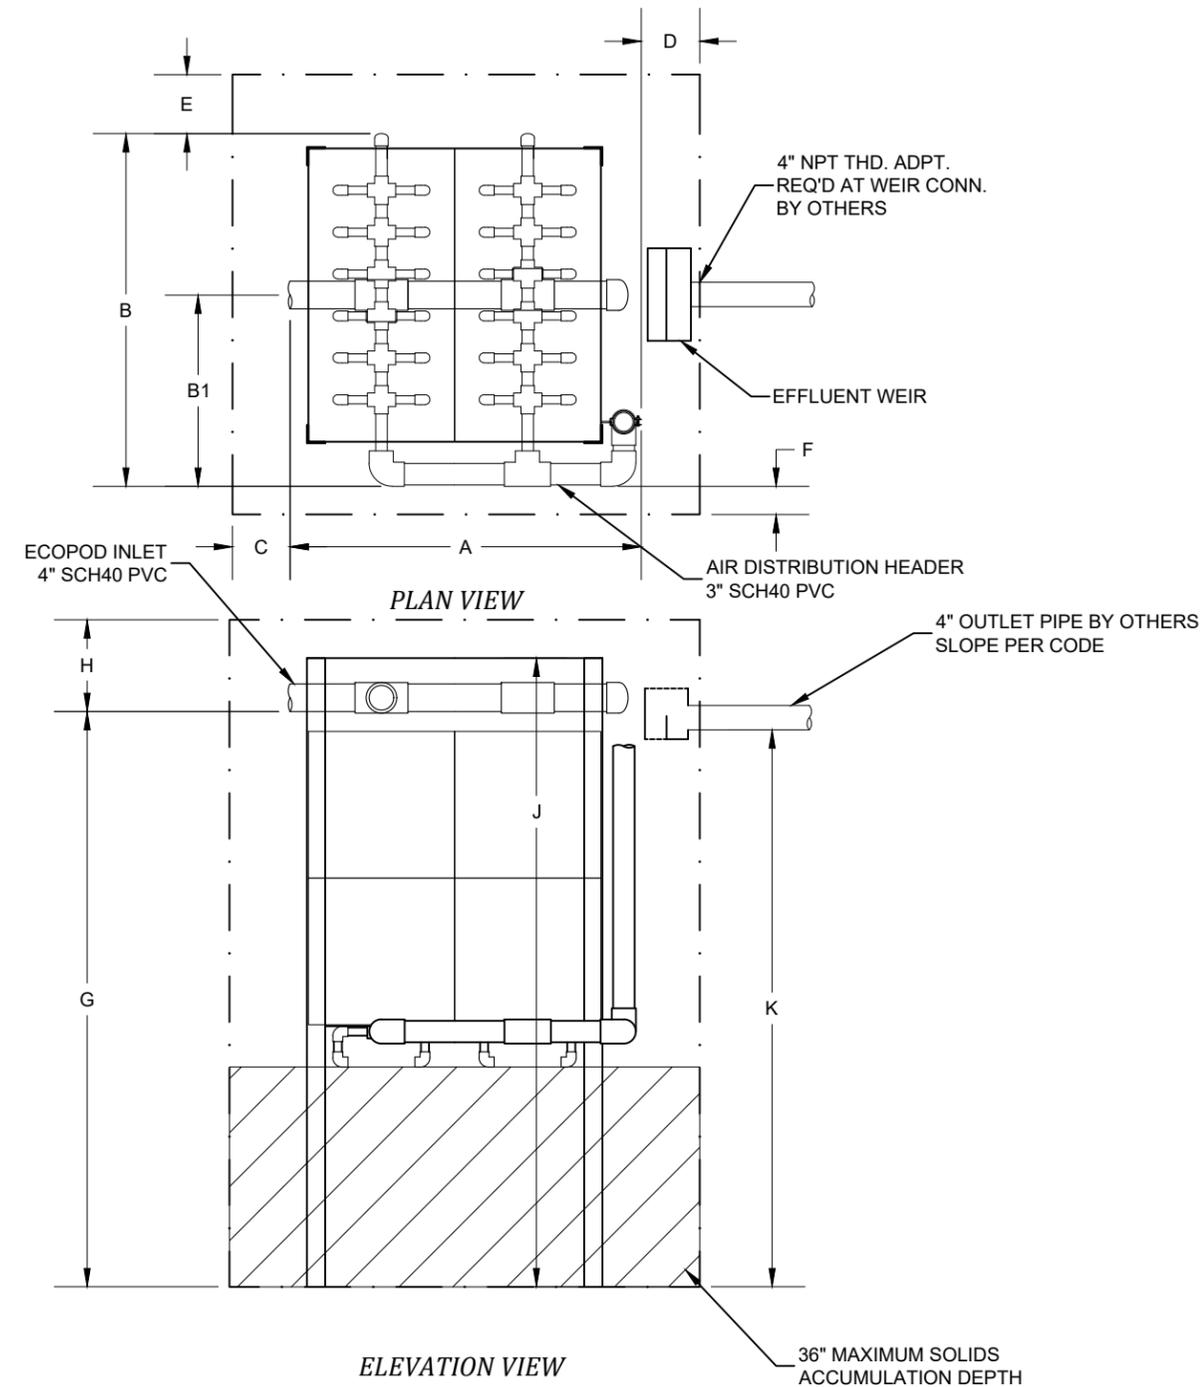

| DIMENSION | IN | CM |
|--------------------------------|----|----|
| C VESSEL FRONT SPACE | 12 | 30 |
| D VESSEL REAR SPACE | 18 | 46 |
| E AIR HEADER SIDE INSIDE SPACE | 6 | 15 |
| F NO HEADER SIDE INSIDE SPACE | 6 | 15 |

| DIMENSION | IN | CM |
|-----------------------------------|-----|-----|
| G INLET INVERT | 92 | 234 |
| H PLENUM SPACE ABOVE INLET INVERT | 10 | 25 |
| J MEDIA REACTOR HEIGHT | 101 | 257 |
| K OUTLET INVERT | 89 | 226 |

1. ONE (1 EA.) INLET AND ONE (1 EA.) OUTLET ACCESS HATCH REQUIRED, 24" DIA MINIMUM.

| NO. | DATE | INITIALS | DESCRIPTION |
|-----|------|----------|-------------|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |


Delta Treatment Systems, LLC
An Infiltrator Water Technologies Company

COPYRIGHT (C) 2021 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF DTS. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.

DELTA ECOPOD E200D
STANDARD DESIGN FOR BOD REDUCTION

GENERAL ARRANGEMENT
LAYOUT DIMENSIONS

| | |
|---------------------|-----------------------|
| HORIZ. SCALE N/A | PROJECT NO. N/A |
| VERT. SCALE N/A | DATE 10/10/2021 |
| DRAWN BY CGK | DESIGNED BY AOB |
| DRAWING NO. C1.1 | SHEET NO. 02 of 02 |

C:\Users\mva\OneDrive\Documents\Delta\ECOPOD\Standard Commercial Work\In Progress\Standard Commercial EcoPod Drawings\WIP Rev A.dwg